

Installation and Maintenance Manual

Forbes Marshall Thermodynamic Trap with Sandwich Ends

FMTD-64-S

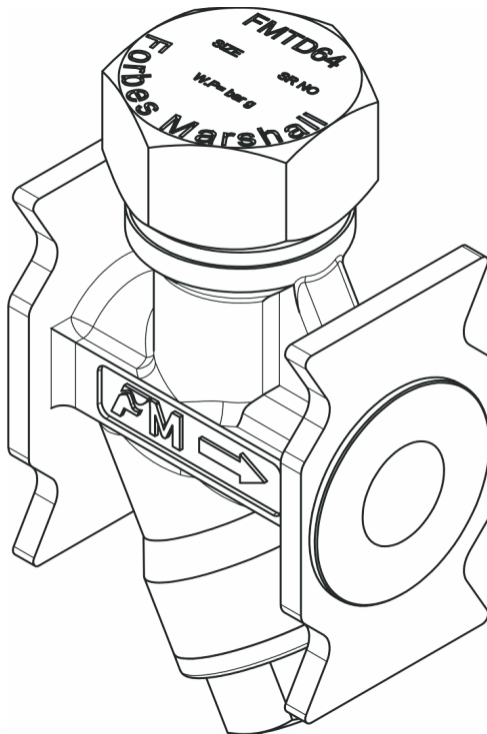


Table of Contents

1.	Preface	1
2.	Important Safety Notes	1
3.	Brief Product Information	3
4.	Product Working Principle	6
5.	Installation Guidelines	7
6.	Start-up and Commissioning	8
7.	Maintenance Guidelines	9
8.	Troubleshooting	12
9.	Available Spares	13
10.	Warranty Period	13

PLEASE NOTE - Throughout this manual this cautionary symbol is used to describe a potential damage or injury that might occur if the safety considerations are overlooked. This symbol denotes **CAUTION**, **WARNING** or **DANGER**.



1. Preface:

This manual is intended for anyone using, commissioning, servicing, or disposing the below mentioned products safely and efficiently.

Forbes Marshall Thermodynamic Trap with Sandwich Ends [FMTD64-S]

Size: DN 15 (½") and DN 20 (¾")

PLEASE NOTE:

Throughout this manual the following cautionary symbol is used to describe a potential damage or injury that might occur if the safety considerations are overlooked.

2. Important Safety Notes:



Read this section carefully before installing/operating/maintaining the product. The precautions listed in this manual are provided for personnel and equipment safety. Furthermore, Forbes Marshall accepts no responsibility for accidents or damage occurring as a result of failure to observe these precautions. Note that the product is designed to perform for non-contaminated fluids only. A contamination in the form of chemical, foreign particle etc. can lead to problem with product performance and life of the product.

If these products in compliance with the operating instructions are, properly installed, commissioned, maintained and installed by qualified personnel (refer Section 2.7) the safety operations of these products can be guaranteed. General instructions for proper use of tools and safety of equipment's, pipeline and plant construction must also be complied with.

2.1 Intended use:

Check if the product is suitable for intended use/ application by referring to the installation and maintenance instructions, name plates and technical information sheets.

- i) The product is suitable for use as defined in the technical information sheet. In case the need arises to use the product on any other fluid please contact Forbes Marshall for assistance.
- ii) Check for the suitability in conformance to the limiting conditions specified in technical information sheet of the product.
- iii) The correct installation and direction of fluid flow has to be determined.
- iv) Forbes Marshall products are not intended to resist external stresses, hence necessary precautions to be taken to minimize the same.

2.2 Accessibility and Lighting:

Safe accessibility and working conditions are to be ensured prior to working on the product.

2.3 Hazardous environment and media:

The product has to be protected from hazardous environment and check to ensure that no hazardous liquids or gases pass through the product.

2.4 Depressurizing of systems and normalizing of temperature:

Ensure isolation and safety venting of any pressure to the atmospheric pressure. Even if the pressure gauge indicates zero, do not make an assumption that the system has been depressurized. To avoid danger of burns allow temperature to normalize after isolation.

2.5 Tools and consumables:

Ensure you have appropriate tools and / or consumables available before starting the work. Use of original Forbes Marshall replacement parts is recommended.

2.6 Protective clothing:

Consider for the requirement of any protective clothing for you/ or others in the vicinity for protection against hazards of temperature (high or low), chemicals, radiation, dangers to eyes and face, noise and falling objects.

2.7 Permits to work

All work to be carried out under supervision of a competent person. Training should be imparted to operating personnel on correct usage of product as per Installation and Maintenance instruction. "Permit to work" to be complied with (wherever applicable), in case of absence of this system a responsible person should have complete information and knowledge on what work is going on and where required, arrange to have an assistant with his primary goal and responsibility being safety. "Warning Notices" should be posted wherever necessary

2.8 Handling:

There is a risk of injury if heavy products are handled manually. Analyze the risk and use appropriate handling method by taking into consideration the task, individual, the working environment and the load.

2.9 Freezing:

Provision should be made to protect systems which are not self-draining, against frost damage (in environment where they may be exposed to temperatures below freezing point) to be made.

2.10 Product Disposal:

It is necessary to dispose this product only in accordance with local regulations at the authorized, qualified collecting point specified for equipment's and its parts—Please refer the part details mentioned in the material table of this manual. Please follow all waste disposal guidelines (Management & Handling) as published by local governing authorities in India & abroad

2.11 Returning products:

Customers and Stockist are reminded that, when returning products to Forbes Marshall they must provide information on any hazards and the precautions to be taken due to contamination residues or mechanical damage which may present a health, safety or environmental risk.

This information must be provided in writing including Health and Safety data sheets relating to any substances identified as hazardous or potentially hazardous.

3. Brief Product Information:

3.1 Description:

The Forbes Marshall Thermodynamic Trap with Sandwich Ends, FMTD64-S, is flange compatible with in-built strainer and full stainless steel construction and is best suited for header and mainline drains and drip legs. FMTD64-S has been specifically designed keeping in mind flanged installations of steam traps on mainline and header drain traps in the most compact manner with least number of welded joints, avoiding space constraints and possibility of leakage.

3.2 Sizes and End Connections:

DN 15, 20

Note :

ASA -150 and 300 compatible

Available with IBR certificate.


3.3 Optional Extras:

Isotub - An insulating cover (part no 6-see overleaf) to prevent the trap being unduly influenced by excessive heat loss such as when subjected to low outside temperature, wind, rain etc

3.4 Limiting Conditions:

PMO : Max. operating pressure	42 bar g
TMO : Max operating temperature	400°C
Hydraulic test pressure	63 bar g
PMOB : Max operating back pressure on outlet should not exceed 80% of inlet pressure.	
Minimum inlet pressure for satisfactory operation	0.25 bar g

3.5 Operating Range:

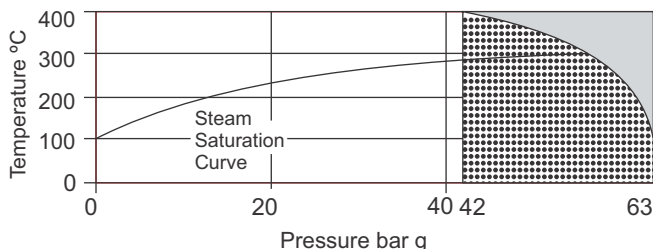

The product must on be used in this region.



The product should not be used in this region or beyond its operating range as damage may occur to the internals.

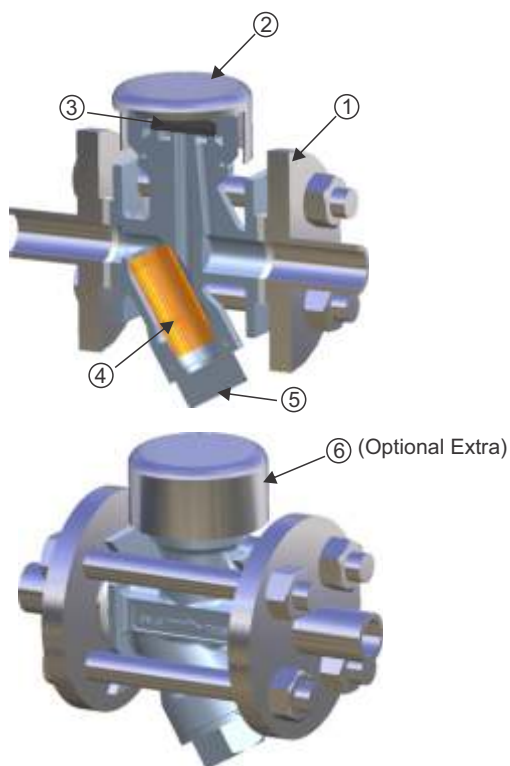


Figure 1: Forbes Marshall Thermodynamic Trap with Sandwich Ends

Material:

Sr. No.	Part	Material	Standard
1	Body	St Steel	ASTM A743 Gr-CA 40
2	Cap	St Steel	BS 3146 PART2 ANC2
3	Disc	St Steel	ASTM A240 SS 420
4	Strainer Screen	St Steel	ASTM A240 Type 304
5	Strainer Cap	St Steel	BS 3146 PART2 ANC2
6	Isotub	St Steel	ASTM A240 type 304

3.6 Product Dimension and Drawing:


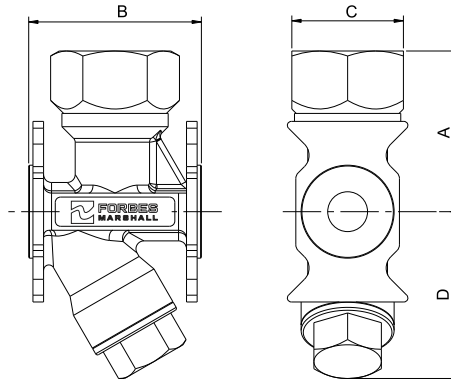


Figure 2: Dimensional drawing of FMTD64-S

Dimensions (approx. in mm)

SIZE	A	B	C	D	Weight
DN15	60.5	65	42	63	0.8 Kg
DN20	65.5	75	42	63	1 Kg

3.7 Capacity Chart:

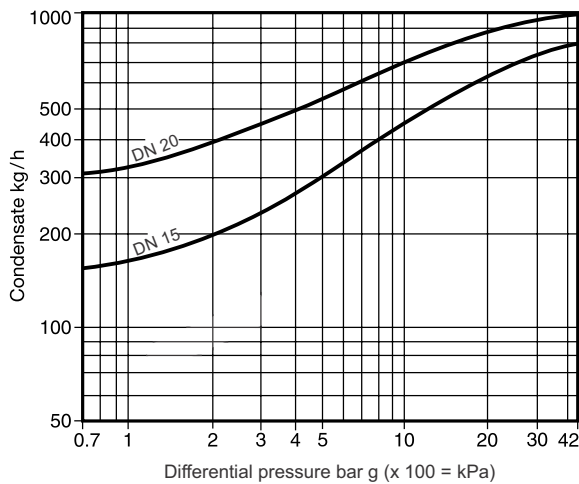

4. Product Working Principle:

The Forbes Marshall Thermodynamic Trap works on thermodynamic principle using the dynamic effect of flash steam as hot condensate passes through the trap.

4.1. Operation of Forbes Marshall Thermodynamic Trap]: [Refer figure 3]

1. The Forbes Marshall Thermodynamic Trap operates on thermodynamic principle using the Bernoulli theorem i.e. the total pressure energy (static and dynamic) for a moving fluid is same at all points.
2. Condensate enters the trap through post integral strainer screen **(E)** in the trap. There is an increase in dynamic pressure of the steam and hot condensate flowing under the disc **(A)** as the velocity of flow increases and consequential drop in static pressure since the total pressure must remain constant, resulting in disc **(A)** being drawn downward to the concentric seat rings **(C)**.
3. As the disc **(A)** is drawn downwards, flash steam passes between the edge of the disc **(A)** and the inner face of the cap **(D)** of the trap. The flash steam occupies the space in the top surface of the disc **(A)**.
4. The flash steam above the disc **(A)** exert pressure on the larger area on the top surface area of disc **(A)** overcomes the inlet pressure acting on a smaller area at the bottom of the disc **(A)**. The disc **(A)** snaps shut against the concentric body seat rings **(C)** and prevents further flow.
5. This position of the disc **(A)** continue until the flash steam above the disc **(A)** starts condensing by radiating heat from the cap **(D)**. Post the condensation of flash steam the pressure acting on top of disc **(A)** is relief and the cycle mention in points 2,3,4 and 5 is repeated.
6. The Forbes Marshall Thermodynamic Trap has an intermittent discharge pattern. The frequency of which is determinant by the condensate load and ambient temperature.

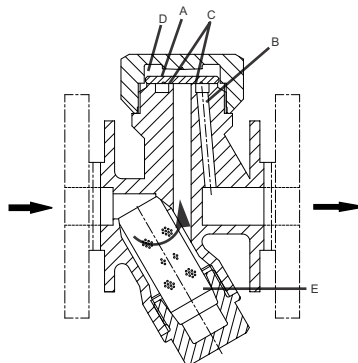


Figure 3 : Forbes Marshall Thermodynamic Trap

5. Installation Guidelines: [Refer figure 4]



Note: Before implementing any installations observe the 'Important Safety Notes' in Section 2. Referring to the installation and maintenance instructions, name – plate and technical information sheet check the product is suitable for the intended installation.

1. Check materials, pressure and temperature and their maximum values.
2. Before installation, flush the inlet drip leg to remove all dirt and oil. Ensure to remove all protective seals from the trap.
3. The Forbes Marshall Thermodynamic Trap should be installed in a horizontal plane such that disc movement happens only in vertically up and down directions.
4. The horizontal mainline should be provided with proper collecting pocket as provided by equal Tee should end with a drip leg and at the end of the drip leg Forbes Marshall Thermodynamic Trap should be fitted. Typically recommended drain pocket dimensions relative to steam main pipe sizes are given below.

Note: Condensate should not be drained through a small pipe connection at the bottom of mainline.

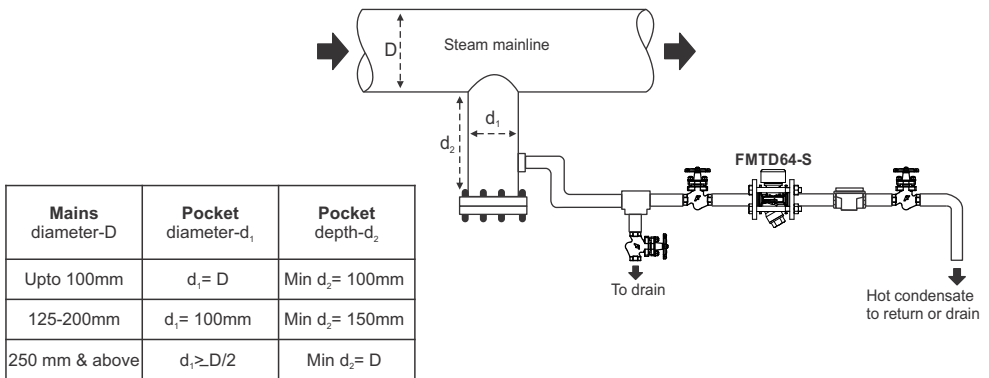


Figure 4: Recommended installation of Forbes Marshall Thermodynamic Trap on mainline

5. Isolation valves should be installed to allow for safe maintenance and trap replacement.
6. Always open isolation valve slowly until normal operation condition is achieved this will avoid system shocks. Check for leaks and attend if any.

Note: If the trap is to discharge to atmosphere ensure it is to safe place, the discharging fluid may be at a temperature of 100°C.

6. Start-up and Commissioning:

6.1. Flushing of lines:

As part of pre-installation all fluid handling equipment particularly piping should be thoroughly cleaned of scale and the internal debris which accumulates during construction. This is accomplished by blowing or flushing with air, steam, water and other suitable medium.

Follow these steps to carry out the flushing.

1. Close the upstream trap isolation valve and open the bypass isolation valve.
2. Let the condensate drain for 10-15 minutes or until clear condensate starts coming out, whichever is earlier.
3. Now slowly close the bypass isolation valve and open the trap isolation valve.

Note: For a detailed procedure on flushing of lines please visit Forbes Marshall

6.2 Commissioning:

After installation or maintenance ensure that the system is fully functioning by confirming fluid is passing through it.

1. After flushing of lines is complete, ensure that bypass isolation valve is closed and upstream trap isolation valve is opened.
2. Check for leaks and attend if any.

7. Maintenance Guidelines:



Note: Before undertaking any maintenance of the product it must be isolated from both supply line and return line and ensure pressure is normalized to atmosphere. The product should then be allowed to cool. When re-assembling ensure that all joint faces are clean.

7.1 Routine and preventive maintenance:

Please refer to the maintenance schedule mentioned in the table below to undertake routine maintenance of the Forbes Marshall Thermodynamic Trap.

No.	Parameters to be checked	Frequency for checking various parameters						
		Immediate	Daily	Weekly	Monthly	Quarterly	Half Yearly	Annually
1	Test High Pressure steam traps (17.5 bar g and above)		Y					
2	Test Medium Pressure steam traps (3.5 bar g to 17.5 bar g)			Y				
3	Test Low pressure steam traps (below 3.5 bar g)				Y			
4	Repair / Replace steam traps - when testing shows leaks	Y						
5	Clean internals / strainer of FMTD64-S					Y		
6	Visual Inspection for leakages			y				
7	Arresting any other leaks	y						

7.2 Tool Kit:

To carry out maintenance of the Forbes Marshall Thermodynamic Trap (FMTD64-S) refer the tools mentioned in the table below.

Size	Component	Tool used and size
DN 15/20	Cap	Box spanner 42 mm (A/F)
	Strainer cap	Box spanner 25 mm (A/F)

7.3 Recommended tightening torques:

Item	Component	Torque Range
2	Cap	180 - 200 Nm
5	Strainer Cap	170- 190 Nm

Table 1: Recommended tightening torque

7.4 Procedure to service trap: [Refer figure 1]

1. Remove the Isotub if fitted and unscrew the main bore cap (2) using box spanner 42 (A/F). Do not use a pipe wrench which may cause distortion of the main bore cap (2).
2. Any minor or major damage / scratch on the seating surface of the disc (3) or body seat (1) will cause the steam trap to pass steam. Since the disc (3) is less hardened than the body seat (3), fine particle passing through the steam trap (along with the condensate) could damage the disc (3). This damage will be in the form of scratches on the disc (3) surface area. If the scratch depth is not much this can be cured by lapping the disc (3) and the steam trap can be made functional. If the body seat (1) is slightly worn out it can be refaced by lapping individual on a glass surface plate. The amount of material to be removed by lapping should not exceed 0.25 mm (0.01").

Lapping Procedure:

- a) Requirement: Emery paper, glass surface, lapping paste and oil.
- b) First, lap the disc on a piece of emery paper (grade 220) to eliminate scratches on the disc and to prepare the surface for further fine lapping.
- c) Apply the lapping paste and oil on to the glass surface and rotate the disc in the shape of the numeric "8" (Eight).
- d) Lapping should be done till all scratches on the disc disappear.

Note: If the scratches on the disc are not curable then the disc should be replaced.

3. When re-assembling main bore cap (2), the disc (3) is normally placed in position with the grooved side in contact with the body seating face (1). No gasket is required but high temperature anti-seize grease should be applied to the threads. The main bore cap (2) should be tighten to the recommended torque (Refer Table 1).

7.5 Procedure to replace the strainer screen: [Refer figure 1]

1. Unscrew the strainer cap (5) using the box spanner 25 (A/F), withdraw strainer screen (4) and clean or if damaged replace with new one.
2. To re-assemble insert the strainer screen (4) in the strainer cap (5), then screw strainer cap (5) into the place with recommended torque (refer Table 1).
3. No gasket is required but a finer smear of Molybdenum Disulphide grease should be applied to the threads.

7.6 Steam traps testing:

Following methods can be used to determine the operating condition of a trap and determine if it's working properly:

1. Testing traps through visual inspection.
2. Testing traps using temperature gun / equipment.
3. Testing traps using sound/ultrasound.
4. Testing traps through online monitoring.

8. Troubleshooting:

If the expected performance is unachievable after installation of the Forbes Marshall Thermodynamic Trap, check the following points for appropriate corrective measures.

Failure Mode	Possible Cause	Remedy
No Condensate is discharged (blocked).	Inlet drip leg or strainer screen is clogged with rust or scale.	Flush inline drip leg and clean strainer screen. If strainer screen is rusted, replace with new strainer screen.
	Differential pressure is low.	Verify inlet and outlet pressure of the steam trap. Minimum differential pressure required is 0.25 bar g.
	Air – binding problem.	Loosen Main bore cap and tighten to suitable torque. Use correct torque mentioned in Section 7.3.
	Steam trap body is hot but no condensate discharge.	To release flash steam locked (trapped) inside the steam trap, pour water on main bore cap of the steam trap to check it discharge condensate.
Steam leakage.	Steam leaking continuously.	Ensure Bypass valve is fully closed.
		Check installation i.e. main bore cap to be on top and Fluid flow direction same as arrow on the steam trap body.
	Foreign material or oil film on disc or body seat.	Clean both disc and body seat, flatness on disc and body seating faces can be improved by lapping individually on flat surface or glass plate. Note: The total amount of metal from body seat face removed should not exceed 0.25mm (0.01").
	Disc stuck to the main bore cap.	Give a light tap on top of the main bore cap and check if step (inner surface of the main bore cap) is worn out. If step is worn out replace with new steam trap.
	Back pressure exceeds allowable value.	Outlet pressure of the steam trap should not exceed 80% of the inlet pressure.
Motor-boating (chattering) of disc.	Scratch on disc or body seat.	Check if scratch depth is less then disc and body seating faces flatness can be improved by lapping individually on flat surface or glass plate. If scratch depth is more replace with new disc. Note: The total amount of metal from body seat face removed should not exceed 0.25mm (0.01").
	Disc or body seat is worn.	Replace with new disc. If body seat is slightly wor can be refaced by lapping on flat surface or glass plate. If body seat is worn more replace with new steam trap. Note: The total amount of metal from body seat face removed should not exceed 0.25mm (0.01").

Note: Never attempt to modify the product. When replacing part with new part, use the spare parts listed in Section 9.

9. Available Spares: (Ref. to fig.5)

The parts available as spares are shown in heavy outline. Parts drawn in dotted line are not available as spares.

SR.NO.	SPARE TYPE	SPARE CONSIST OF	SPARE SPECIFICATION	SPARE CODE
1	SCREEN AND DISC KIT	SCREEN AND DISC (PACK OF 5 EACH)	DN15	SPARE-15FMTD64-SDKIT
2	SCREEN AND DISC KIT	SCREEN AND DISC (PACK OF 5 EACH)	DN20	SPARE-20FMTD64-SDKIT
3	ISOTUB KIT	ISOTUB (PACK OF 1)	DN15/20	SPARE-1520FMTD64-ISTBKIT

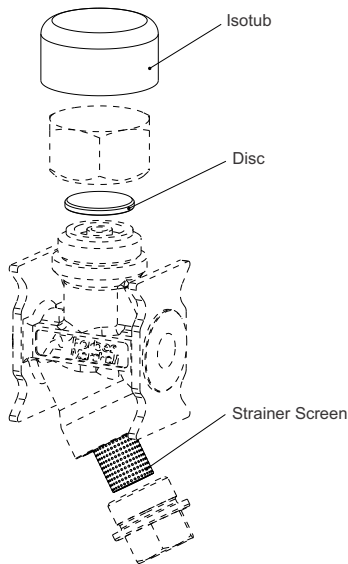


Figure 5: Parts Available as spares (Heavy outline) for FMTD64-S

How to Order:

Example : 1no. DN15 Forbes Marshall Thermodynamic Trap with sandwich ends, FMTD64-S, IBR.

How to Order Spares:

Always order spares by using the description given in the column headed "Available Spares" and stating the size and type of trap.

10. Warranty Period:

As per ordering information and agreements in the contract.



www.forbesmarshall.com

Forbes Marshall Arca

Codel International

Krohne Marshall

Forbes Vyncke

Forbes Marshall Steam Systems

A: Forbes Marshall Pvt. Ltd.

Opp. 106th Milestone, CTS 2220,
Mumbai-Pune Road, Kasarwadi,
Pune MH 411034 INDIA

P: +91(0)20-68138555

F: +91(0)20-68138402

E: ccmidc@forbesmarshall.com

Forbes Marshall International Pte. Ltd.

16A, Tuas Avenue 1,
#05-21, JTC Space @Tuas
Singapore - 639533

P: +65 6219 3890

CIN No: U28996PN1985PTC037806